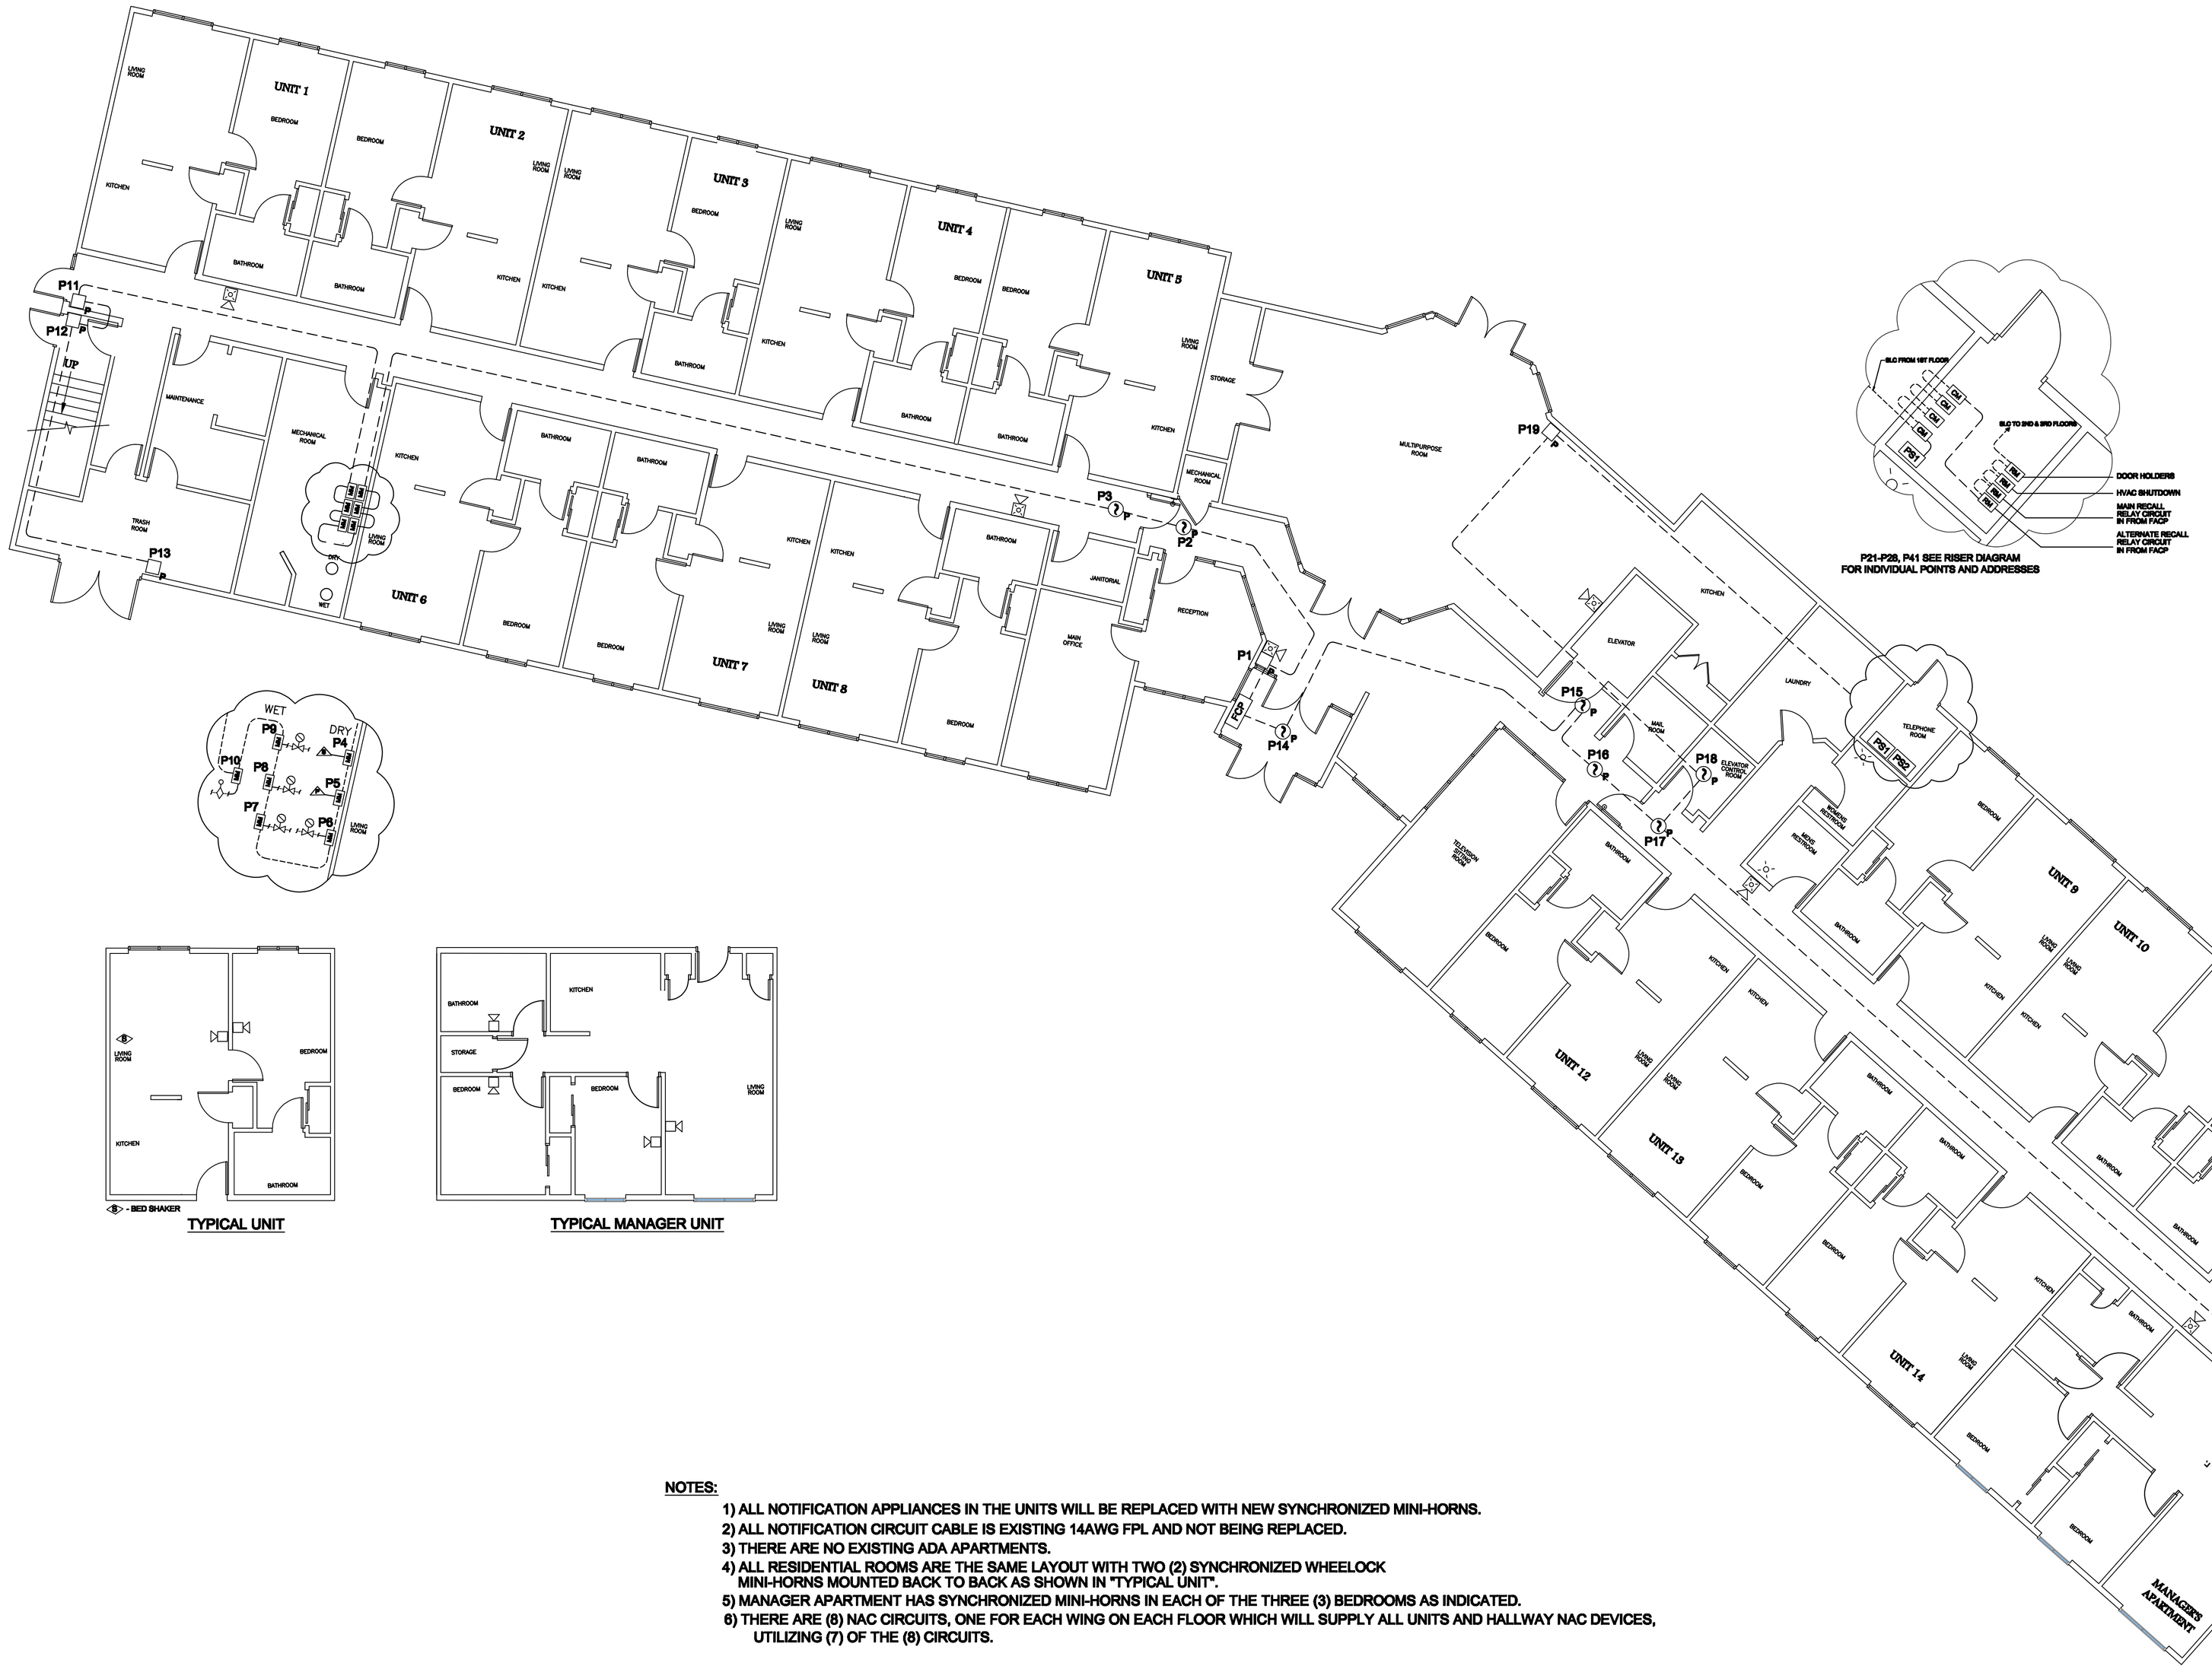

TYPICAL UNIT

TYPICAL MANAGER UNIT

NOTES:

1) ALL NOTIFICATION APPLIANCES IN THE UNITS WILL BE REPLACED WITH NEW SYNCHRONIZED MINI-HORNS.
2) ALL NOTIFICATION CIRCUIT CABLE IS EXISTING 14AWG FPL AND NOT BEING REPLACED.
3) THERE ARE NO EXISTING ADA APARTMENTS.
4) ALL RESIDENTIAL ROOMS ARE THE SAME LAYOUT WITH TWO (2) SYNCHRONIZED WHEELOCK MINI-HORNS MOUNTED BACK TO BACK AS SHOWN IN "TYPICAL UNIT".
5) MANAGER APARTMENT HAS SYNCHRONIZED MINI-HORNS IN EACH OF THE THREE (3) BEDROOMS AS INDICATED.
6) THERE ARE (8) NAC CIRCUITS, ONE FOR EACH WING ON EACH FLOOR WHICH WILL SUPPLY ALL UNITS AND HALLWAY NAC DEVICES, UTILIZING (7) OF THE (8) CIRCUITS.

NICET CERTIFIED
#116837

BILL GARRISON, SET
LEVEL IV
FIRE ALARM SYSTEMS

YOUR COMPANY HERE
YOUR STREET ADDRESS
YOUR TOWN, YOUR STATE, USA
PHONE: (555) 555-1234
FAX (555) 555-1235

SYSTEM DESIGNER & INSTALLER:
YOUR LOGO HERE

XYZ FACILITY

XYZ Drive
Anywhere, Colorado 80910

DATE OF REVISION	01 NOV 2010
PROJECT #	70501
SHEET DESCRIPTION	BASEMENT DEVICE LAYOUT
SHEET NUMBER	FA-3